


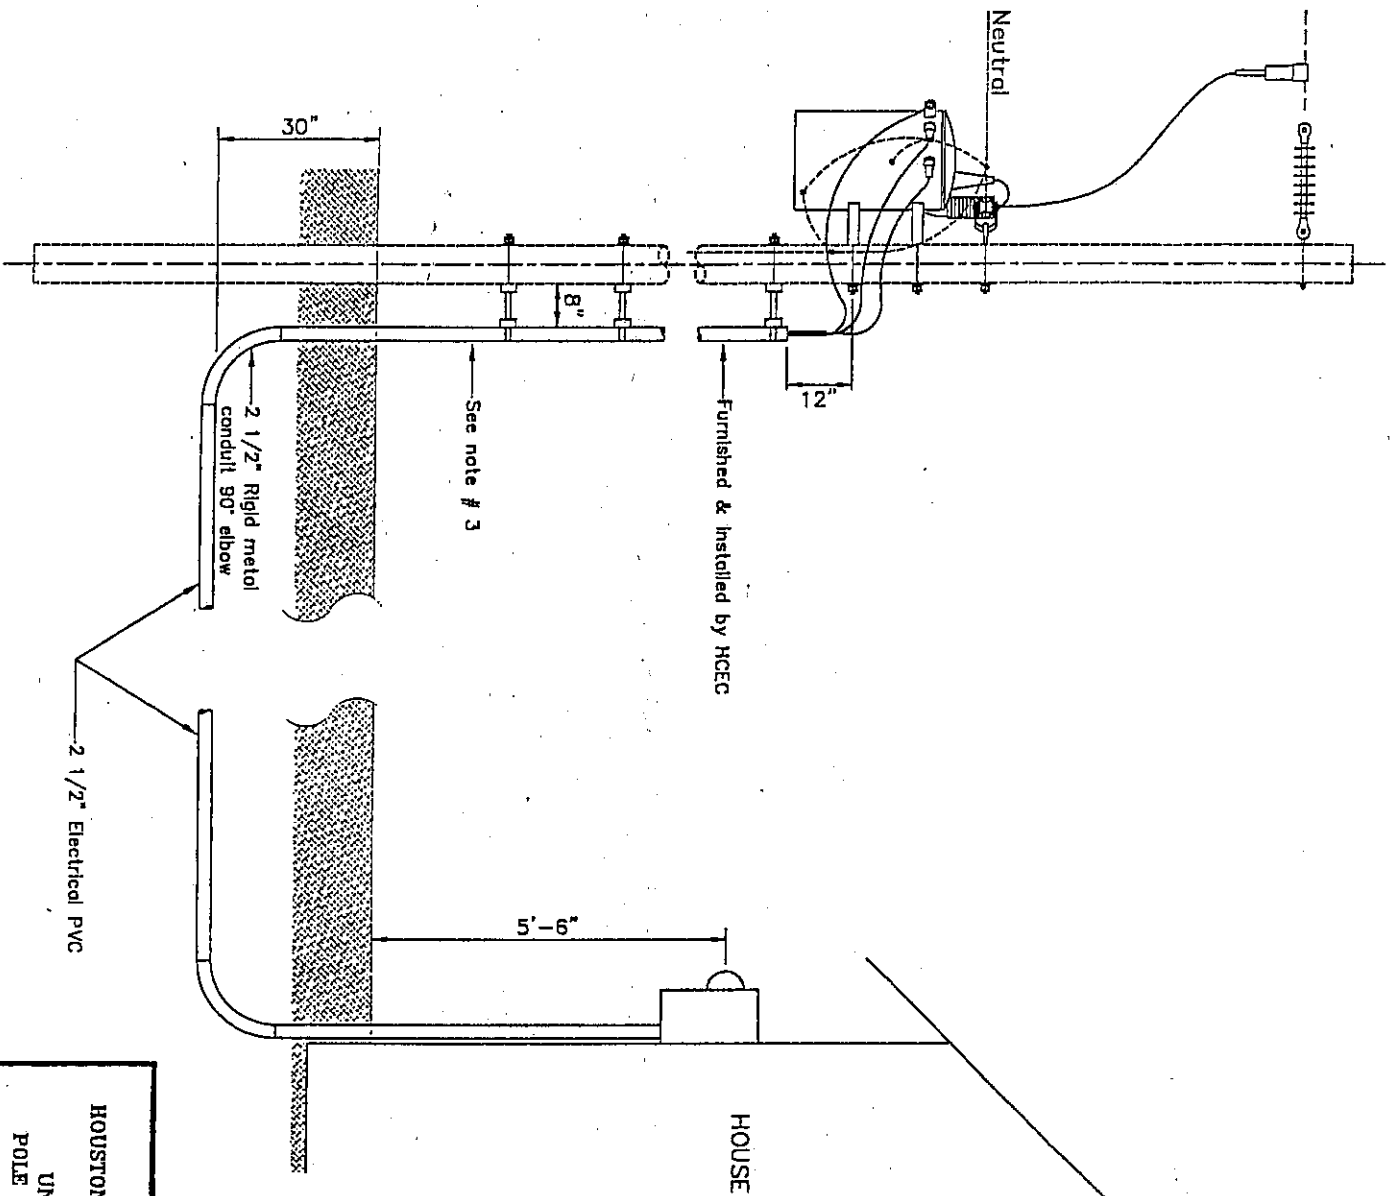

NOTES:

1. Customer will be responsible for digging ditch and installing wire in conduit with elbow. Minimum depth of 30".
2. Coop will furnish wire from house to transformer and underground meter base.
3. Consumer to install up to 18" AGL with threaded nipple.

HOUSTON COUNTY ELECTRIC COOPERATIVE
CROCKETT, TEXAS
UNDERGROUND SPECIFICATION
POLE CONDUIT TO METER ON HOUSE

DATE: 7-12-98

DFT.CEB ENG.JTC

ENGINEER No.

88-031